



Turkey (Grade A) - 13lbs Temperature Log

General

Date
October 8, 2018


Temperature
-2°C

Humidity
93% RH

Standards

Manufacturer: Hui Gardens
Model: HF3
Description: WiFi RTD Meat Smoker Temperature Transmitter
Serial Number: 888

Manufacturer: Traeger
Model: PT1000 RTD Probe
Description: 2 Wire PT1000 RTD Probe 385
Serial Number: None

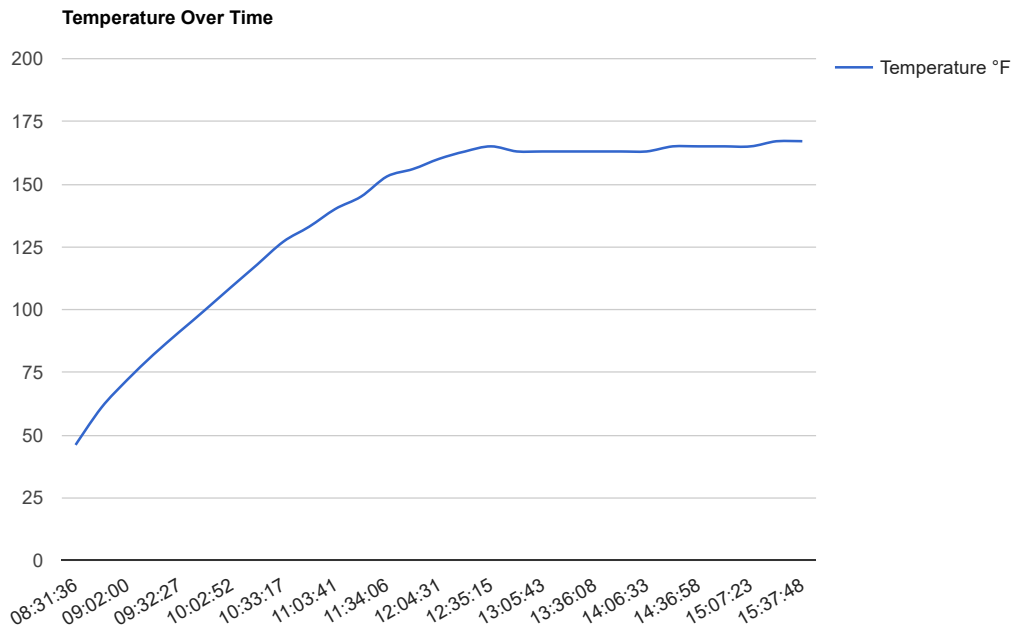

Data

Time	Temperature °C	Temperature °F	Resistance Ω
2018-10-08 15:53:01	75	167	1291.916
2018-10-08 15:37:48	75	167	1291.522
2018-10-08 15:22:35	75	167	1290.210
2018-10-08 15:07:23	74	165	1288.766
2018-10-08 14:52:11	74	165	1287.454
2018-10-08 14:36:58	74	165	1287.717
2018-10-08 14:21:45	74	165	1286.798
2018-10-08 14:06:33	73	163	1285.617
2018-10-08 13:51:20	73	163	1284.174
2018-10-08 13:36:08	73	163	1283.649
2018-10-08 13:20:56	73	163	1282.993
2018-10-08 13:05:43	73	163	1282.993
2018-10-08 12:50:31	73	163	1283.255
2018-10-08 12:35:15	74	165	1286.536
2018-10-08 12:19:44	73	163	1283.911
2018-10-08 12:04:31	71	160	1277.350
2018-10-08 11:49:19	69	156	1269.476
2018-10-08 11:34:06	67	153	1259.766
2018-10-08 11:18:54	63	145	1245.200
2018-10-08 11:03:41	60	140	1233.783
2018-10-08 10:48:29	56	133	1220.660
2018-10-08 10:33:17	53	127	1205.701
2018-10-08 10:18:04	48	118	1188.773
2018-10-08 10:02:52	43	109	1169.089
2018-10-08 09:47:39	38	100	1149.142
2018-10-08 09:32:27	33	91	1129.065
2018-10-08 09:17:13	28	82	1109.250
2018-10-08 09:02:00	22	72	1089.172
2018-10-08 08:46:48	16	61	1063.452
2018-10-08 08:31:36	8	46	1031.433

As Found



As Left



Technician

Wilson Hui

Approved By

Elsie Hui
Manager

Hui Gardens certifies that the above item was NOT calibrated in compliance with the requirements of ISO/IEC 17025:2005, and/or the technical requirements of the customer. Hui Gardens' quality management system is non-existent. All Hui Gardens measurements are NOT traceable to SI units through the National Research Council (NRC), the National Institute of Standards and Technology (NIST), other National Measurement Institutes (NMIs), or to physical constants, consensus standards, or ratio measurements. Measured values apply only at the time of calibration. After that time any number of factors may cause measured values to change. The information in this document applies only to the identified item.